



BATHROOM ACCESSORY SCHEDULE FOR 2-BR. UNIT

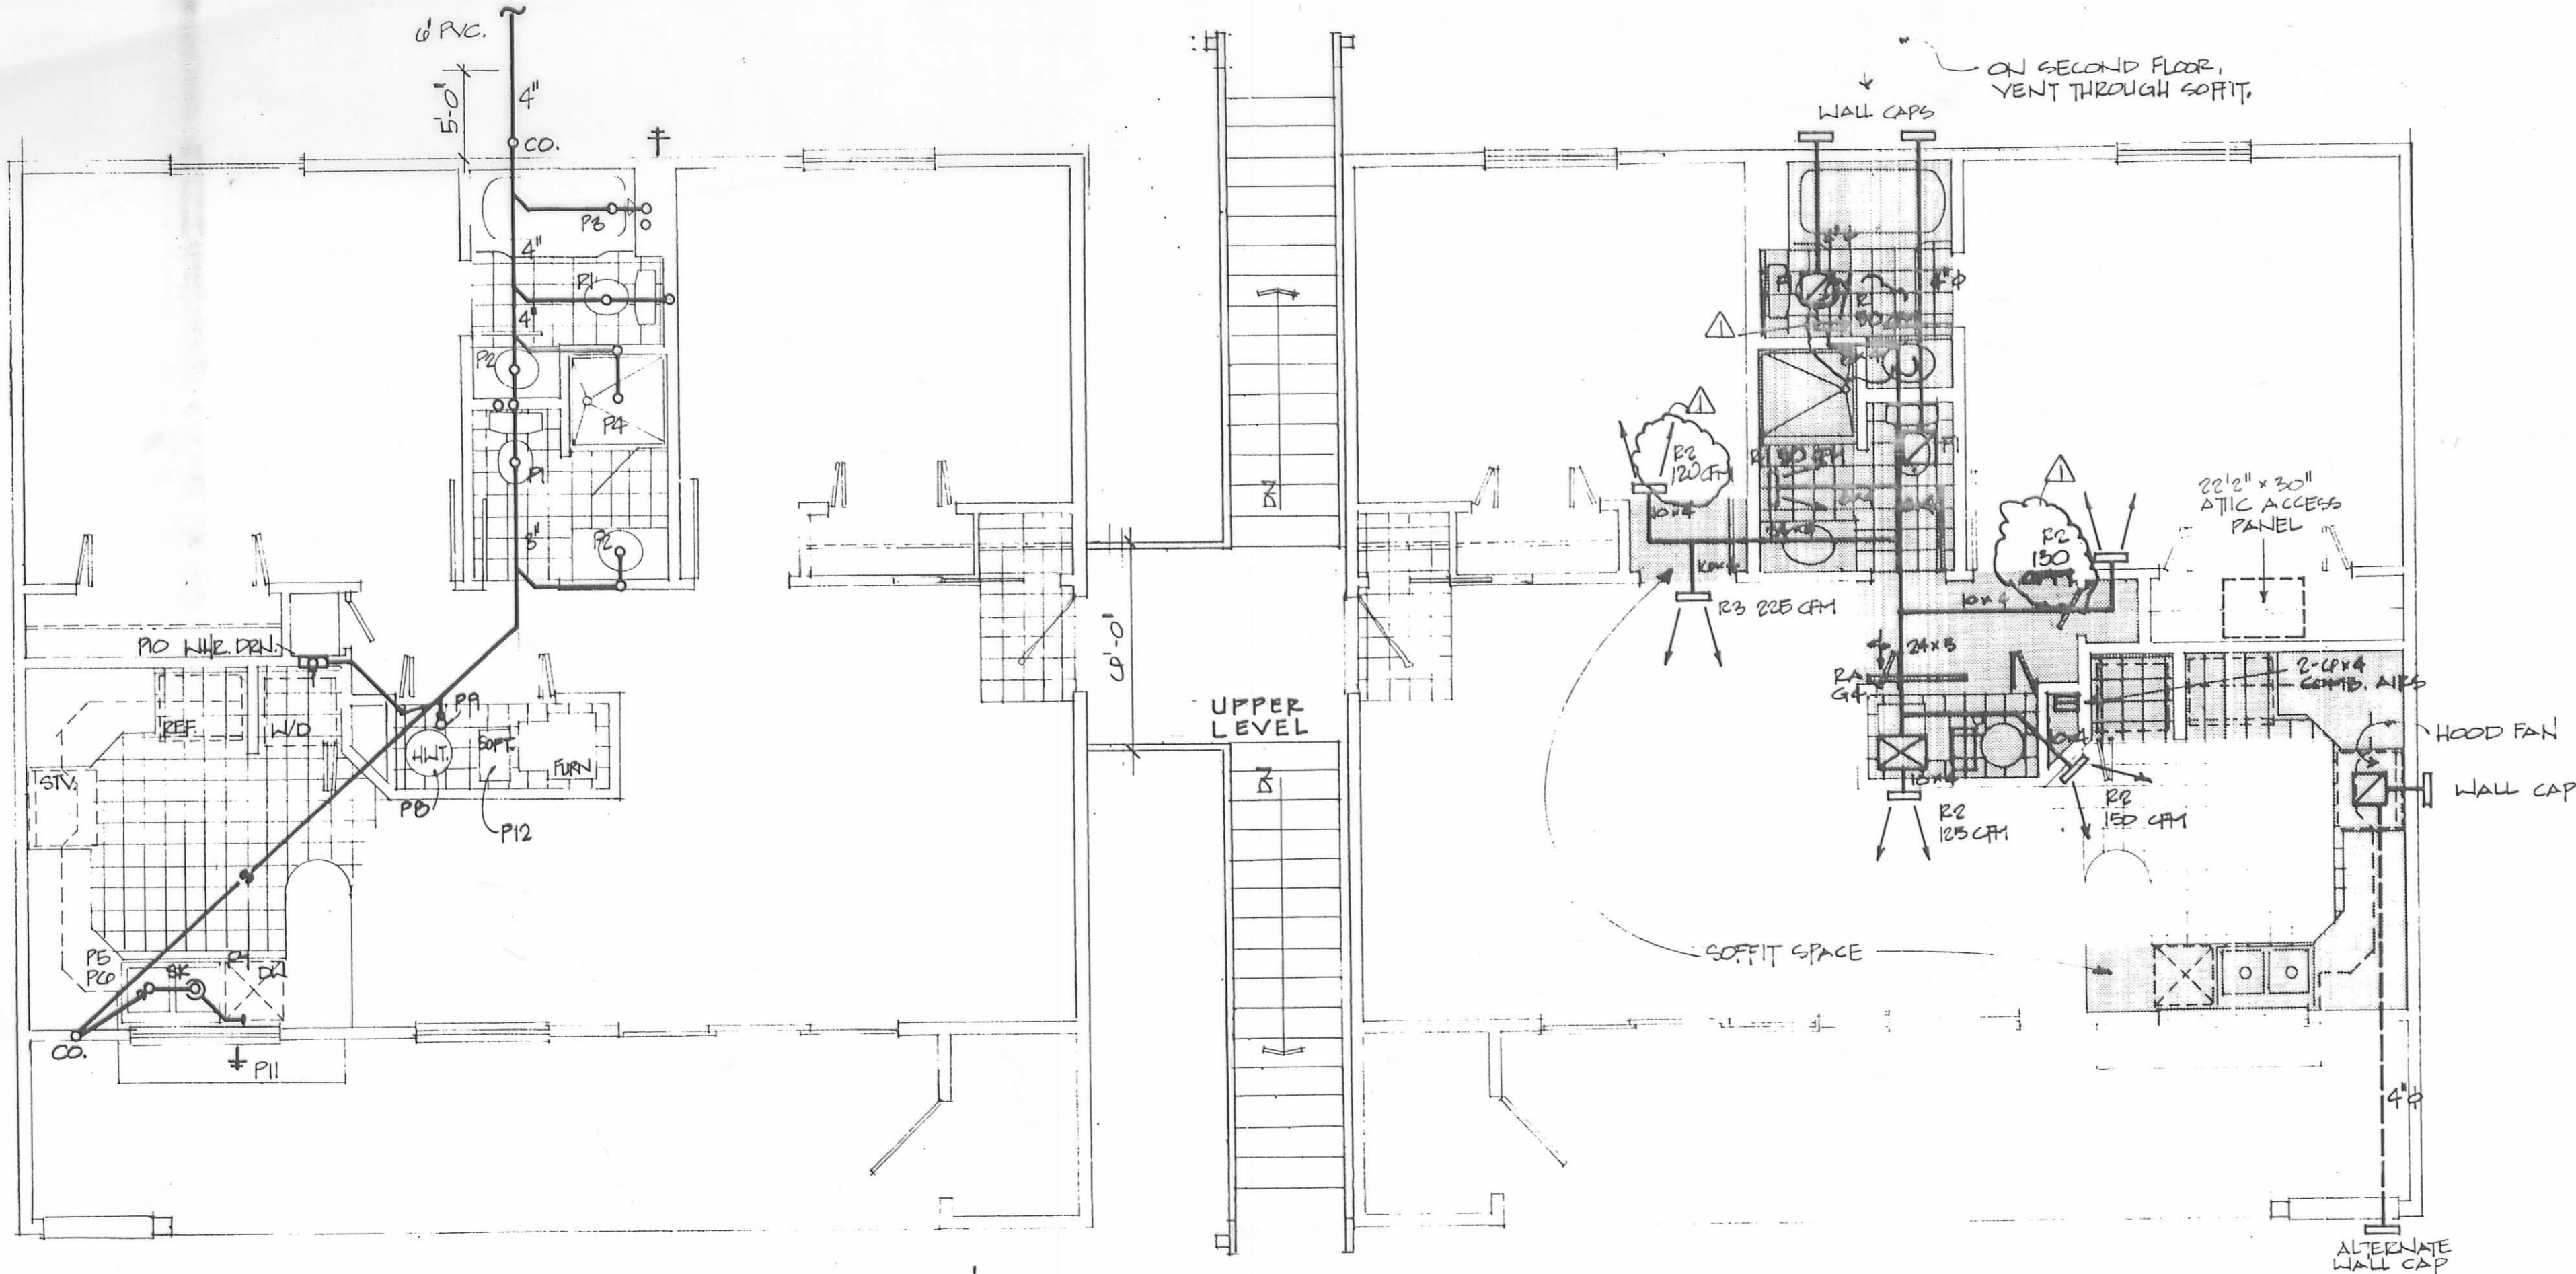


PLUMBING PLAN (TYP)

HVAC PLAN (TYP)

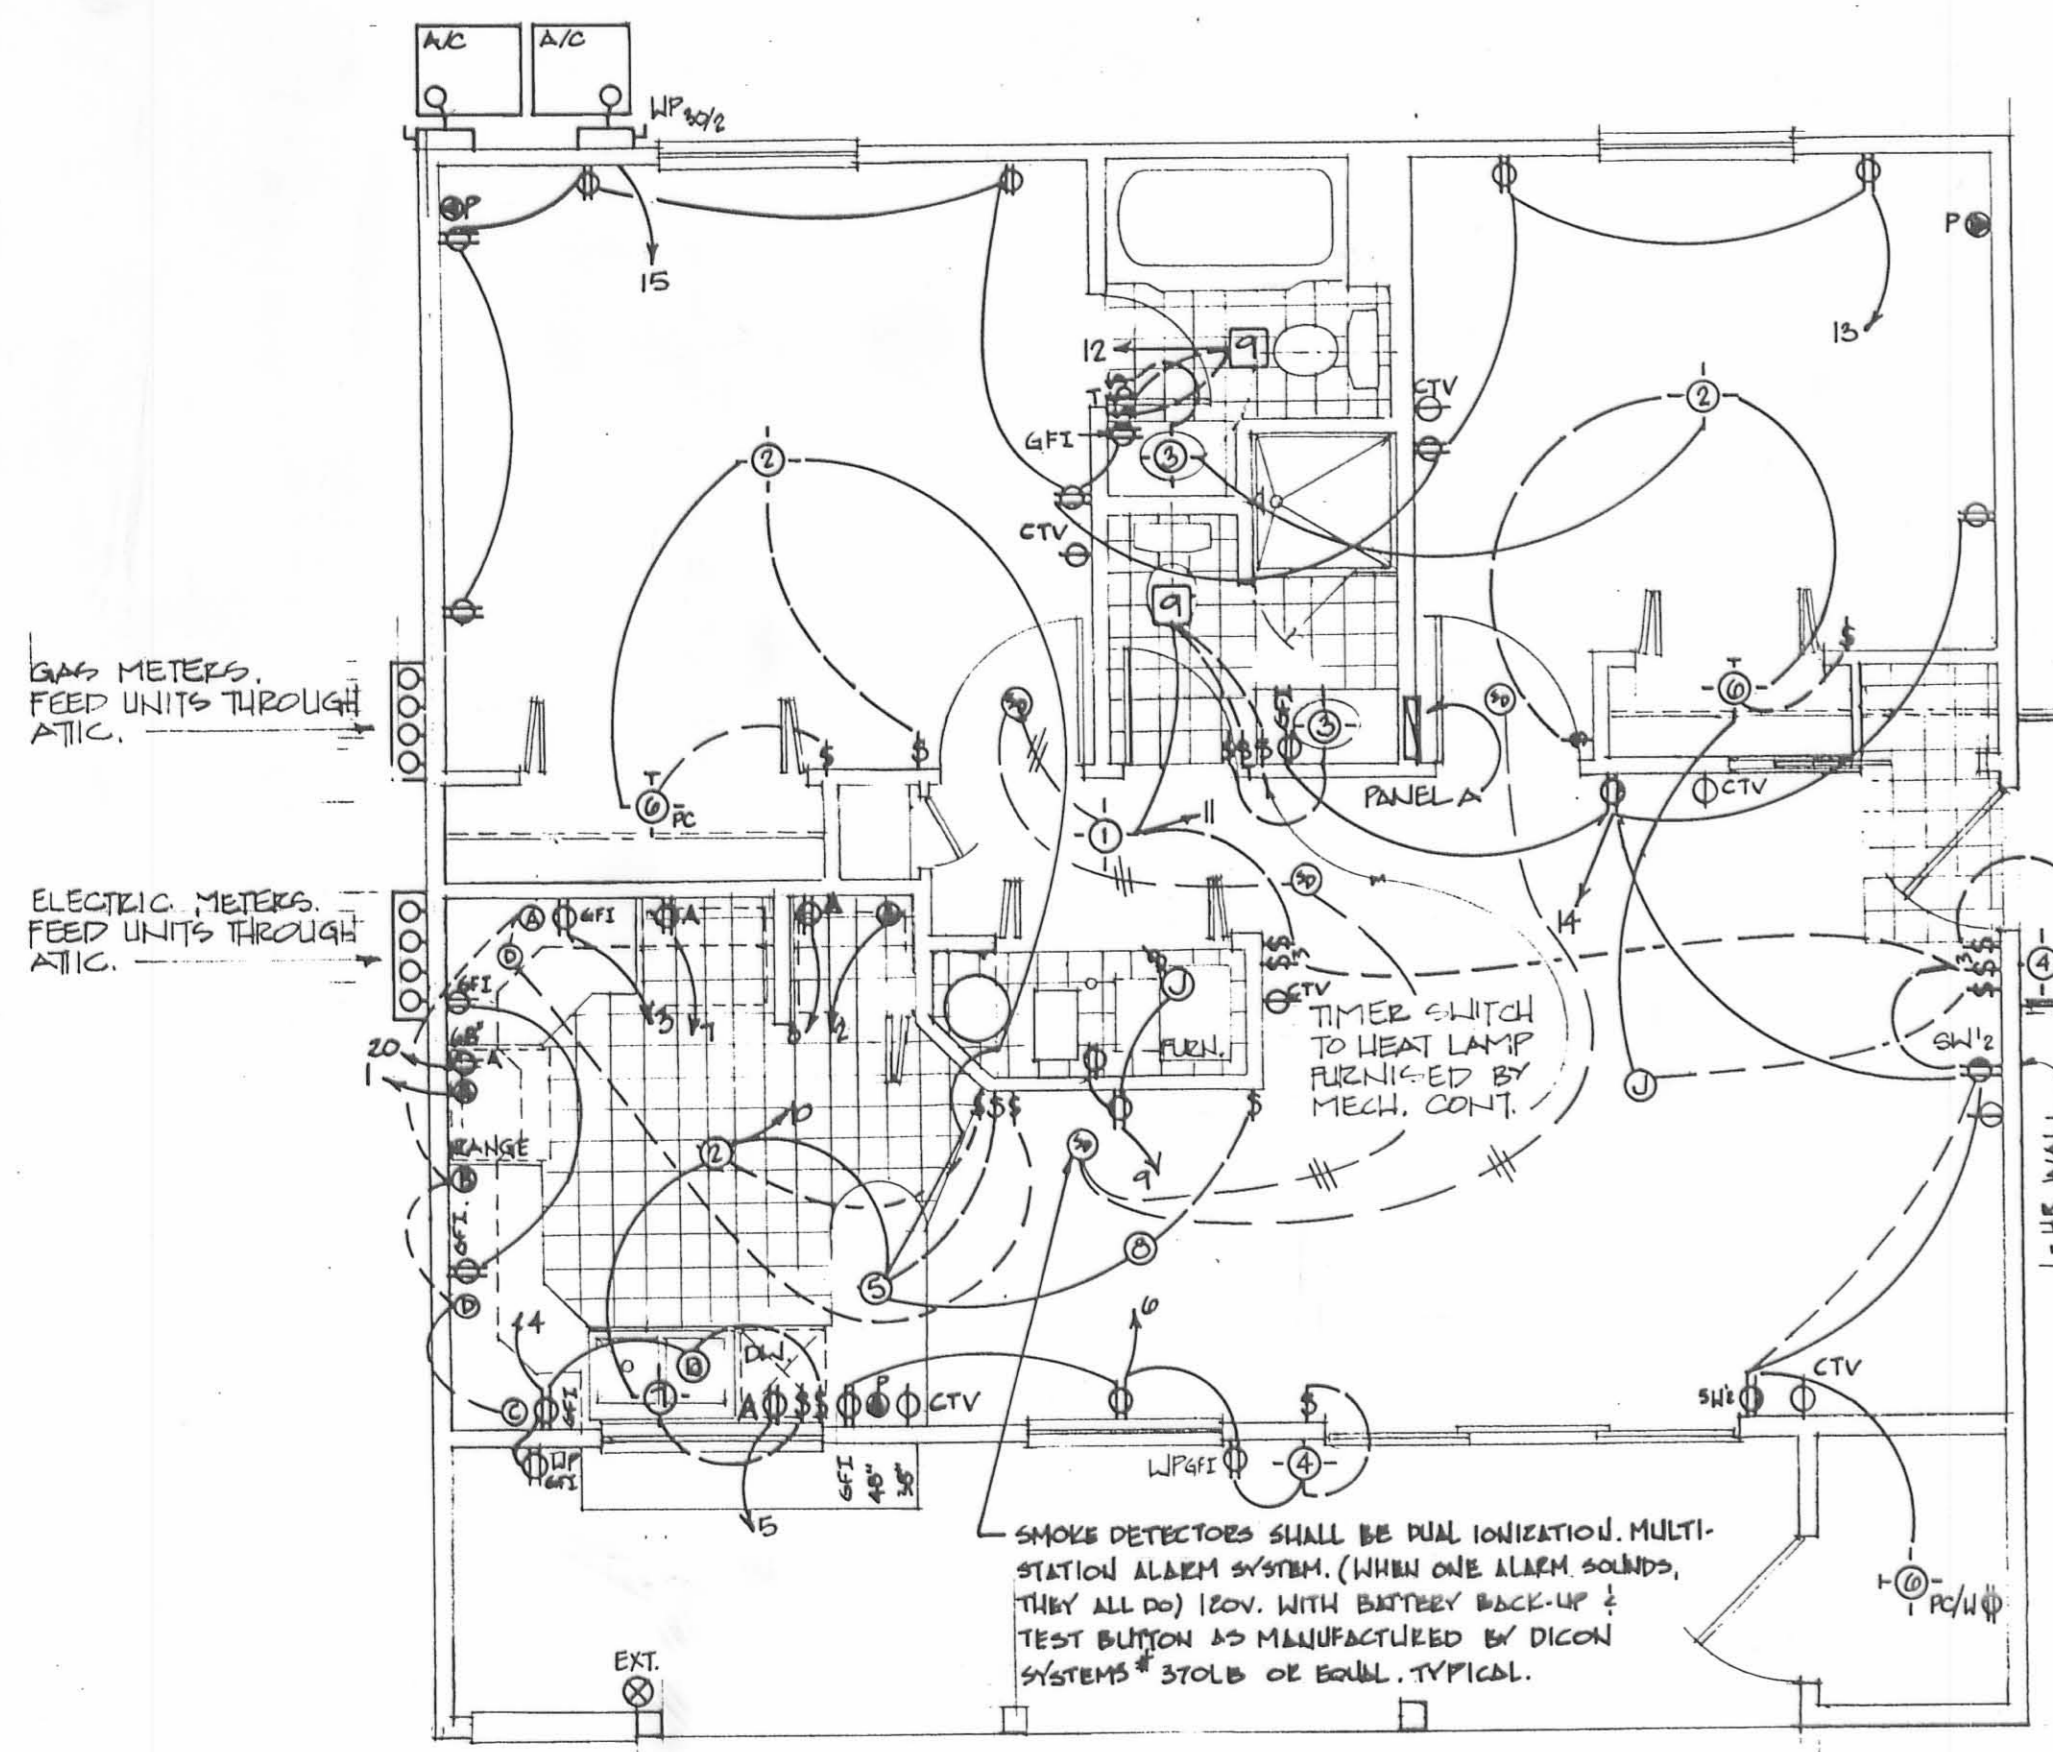

ELECTRICAL PLAN (TYP)

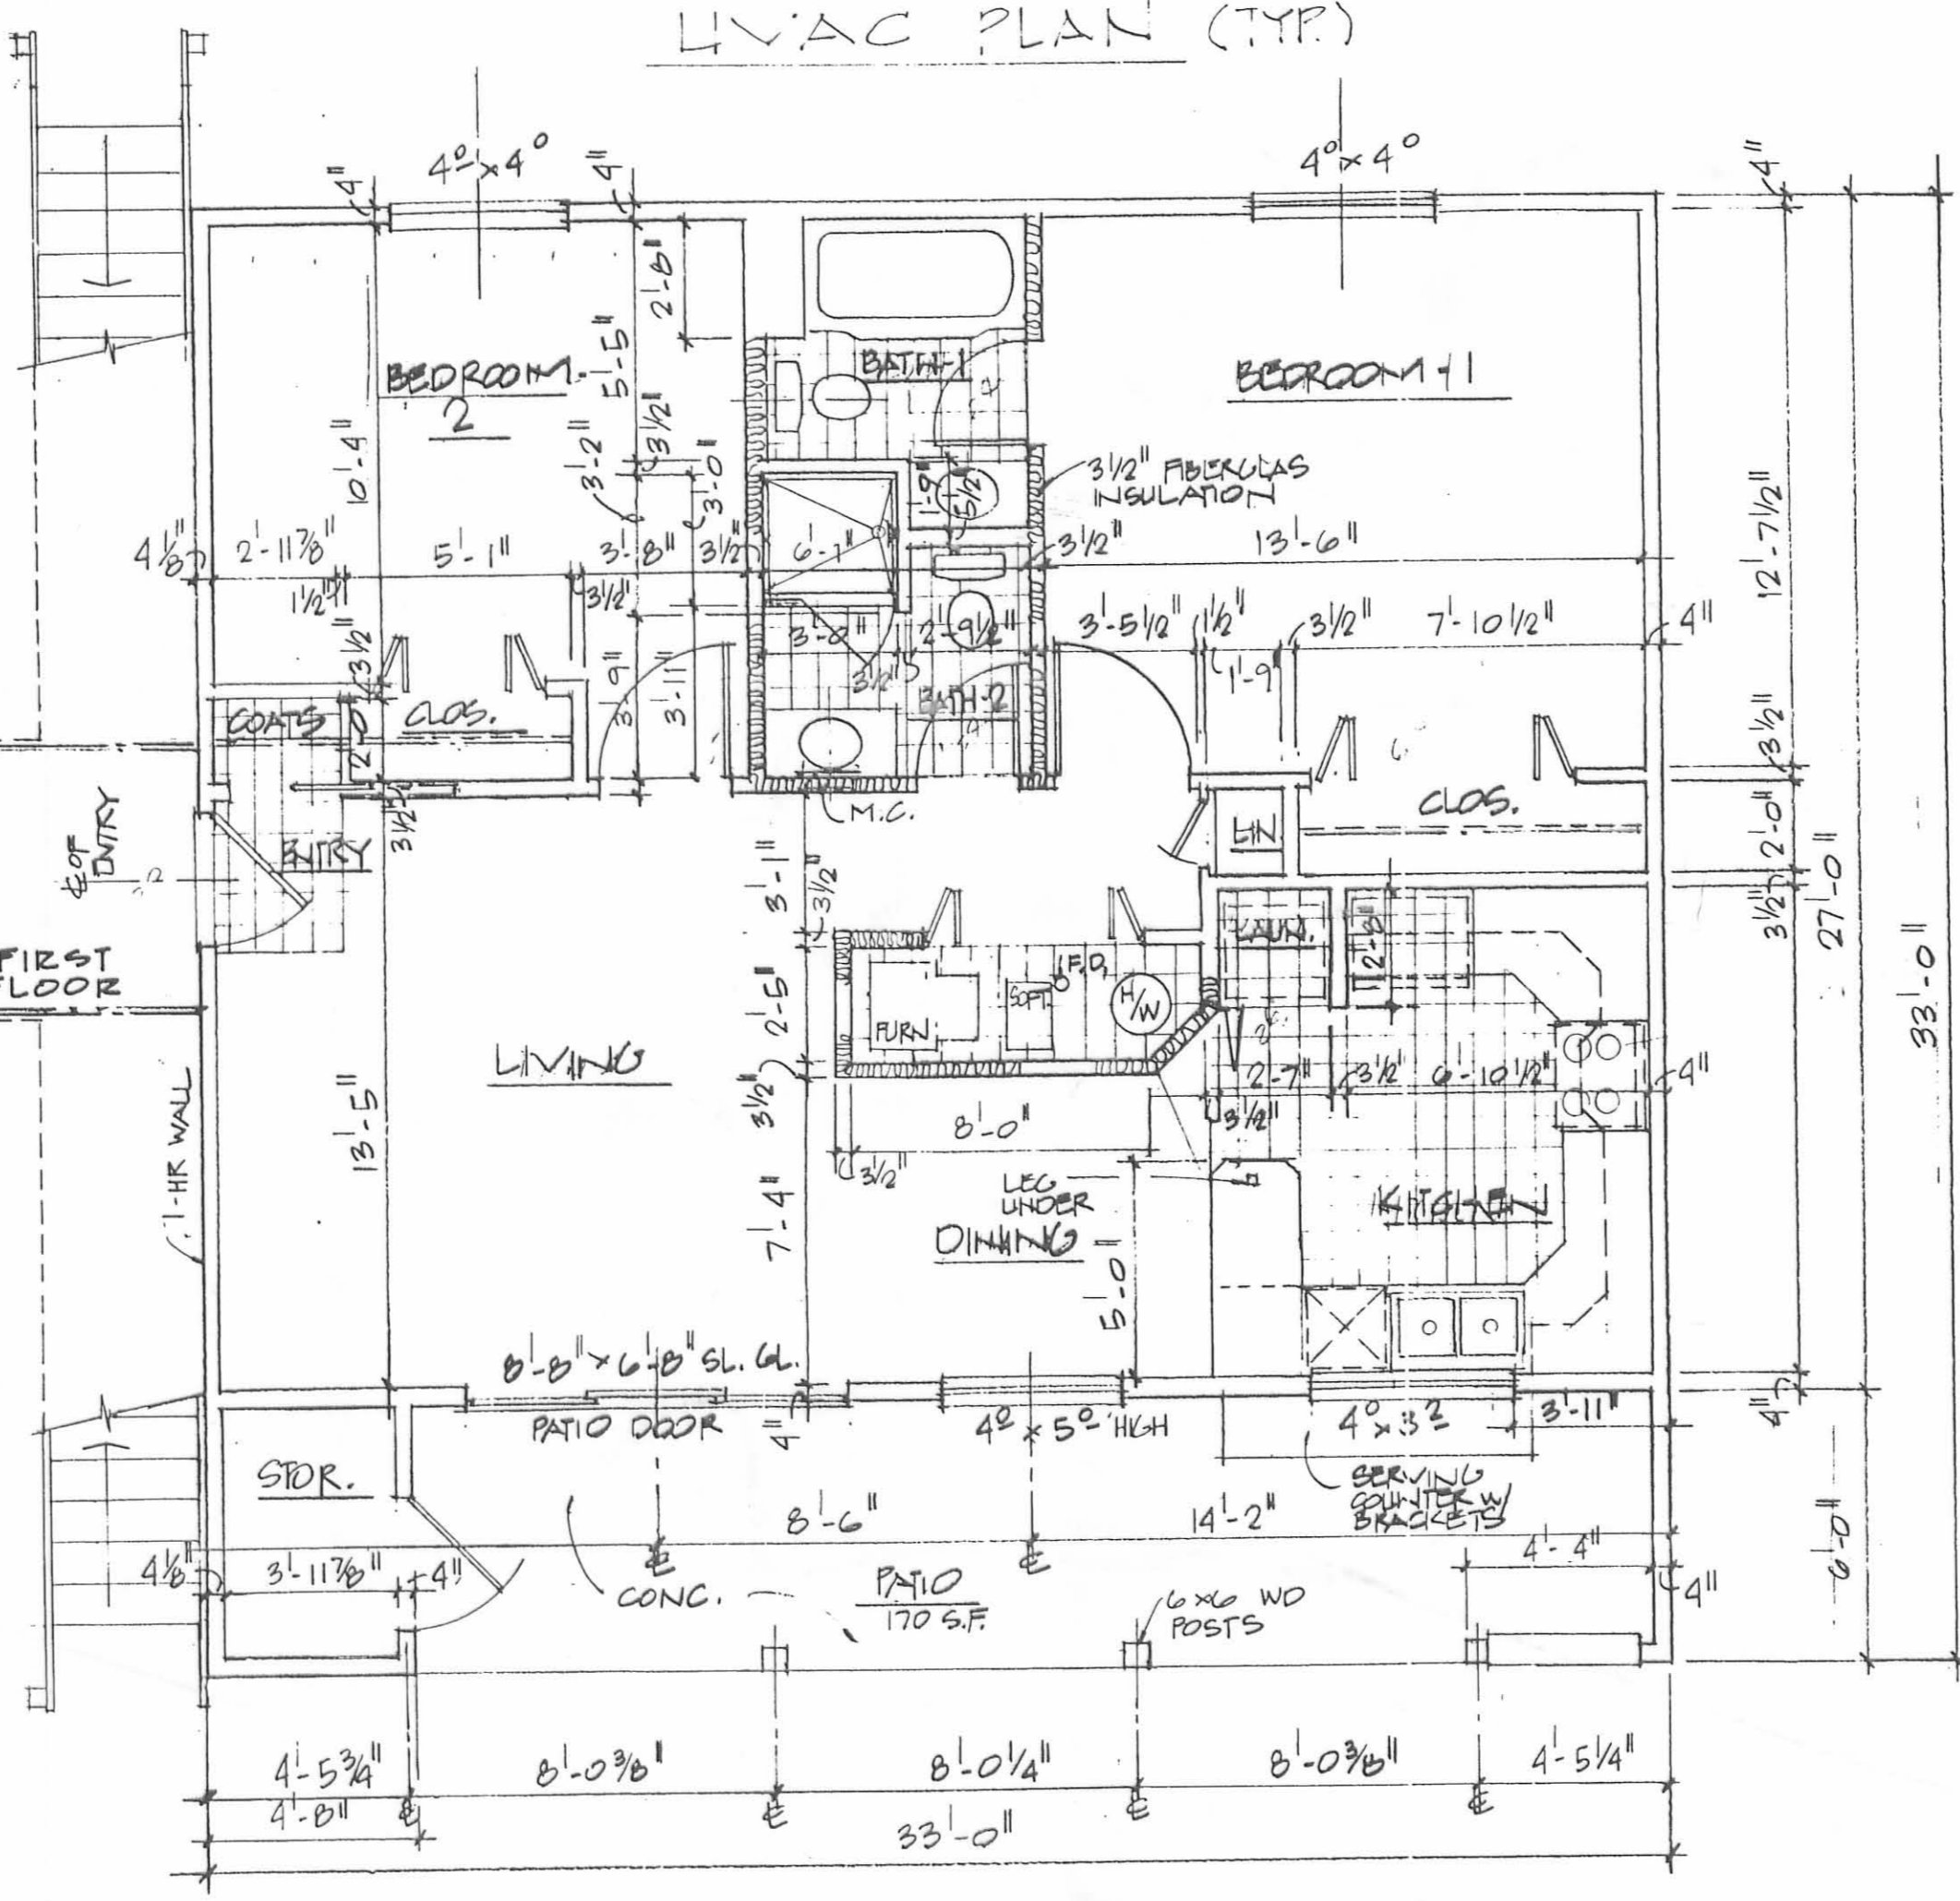

FLOOR PLAN 1/4"
 GROSS AREA: 919 S.F.

SMOKE DETECTORS SHALL BE DUAL IONIZATION, MULTI-STATION ALARM SYSTEM. (WHEN ONE ALARM SOUNDS, THEY ALL GO) 120V. WITH BATTERY BACK-UP & TEST BUTTON AS MANUFACTURED BY DICON SYSTEMS* STDB. OF B04L. TYPICAL.